



DUPLEX OUTLET
LOCATED IN
APPROXIMATE
AREA SHOWN

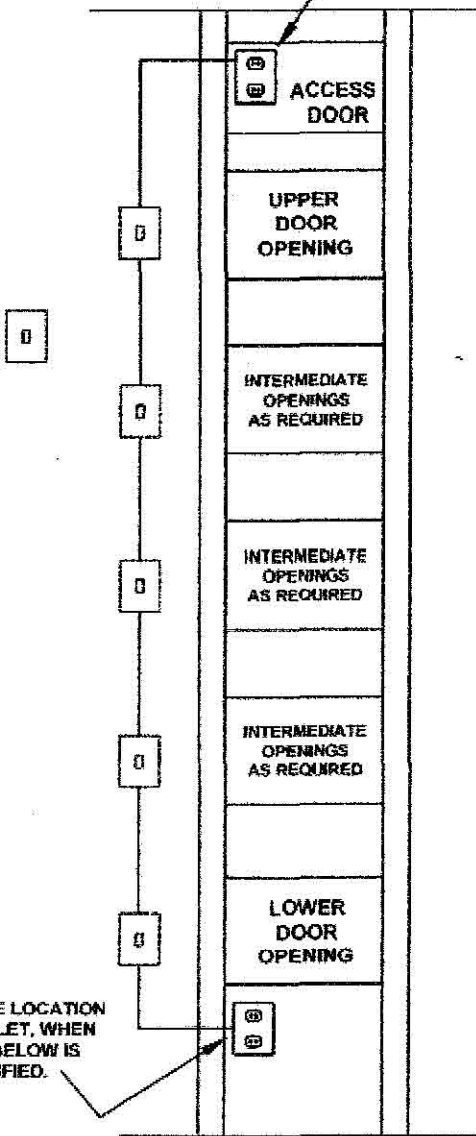

ALTERNATE LOCATION
FOR OUTLET, WHEN
MOTOR BELOW IS
SPECIFIED.


110 VOLT
SUPPLY



TOGGLE SWITCHES
TO BE SINGLE POLE
WIRED IN SERIES.
POWER FEED TO
CIRCUIT CAN BE AT THE
DECRETION OF
THE ELECTRICIAN.

ADDITIONAL SWITCHES
AT EACH LEVEL FOR
MULTIPLE FLOOR UNITS.

WIRES AND WIRING TO MEET ALL
LOCAL AND NATIONAL ELECTRICAL CODES.

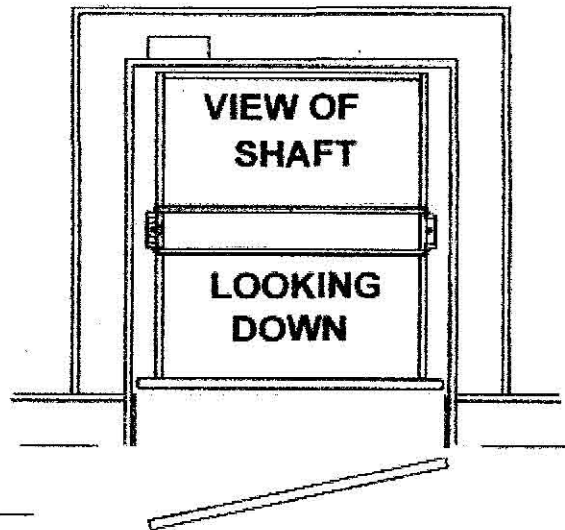

TOGGLE SWITCHES ARE ONLY USED TO STOP THE UNIT IN AN EMERGENCY AND SHOULD BE LOCATED AT A HEIGHT THAT IS ACCESSIBLE TO ANYONE OPERATING THE UNIT. THE CALL CONTROLS SHOULD BE MOUNTED HIGH ENOUGH THAT THEY CANNOT BE REACHED BY SMALL CHILDREN.

**ULTIMATE DIE
CORPORATION**
TAMPA, FLORIDA
1-800-825-3880.

110 VOLT ELECTRICAL	
REQUIREMENTS	
REVISED 3-1-07	